

**Duct Sensor CO<sub>2</sub> / Humidity / Temperature**

For measuring CO<sub>2</sub>, with integrated temperature and humidity sensor. Dual channel CO<sub>2</sub> technology. With Modbus RTU communication and integrated 0 ... 10V outputs. IP65 / NEMA 4X rated enclosure.


**Type Overview**

| Type     | Output signal | Output signal active CO <sub>2</sub> | Output signal active temperature |
|----------|---------------|--------------------------------------|----------------------------------|
| 22DTM-15 | Modbus        | DC 0...5 V,<br>DC 0...10 V           | DC 0...5 V,<br>DC 0...10 V       |

**Technical Data**

|                        |                           |  |
|------------------------|---------------------------|--|
| <b>Electrical data</b> | Power supply DC           | 15...24 V, ±10%, 0.3 W   |
|                        | Power supply AC           | 24 V, , ±10%, 6 VA   |
|                        | Electrical connection     | Removable spring loaded terminal block max. 2.5 mm <sup>2</sup>  |
| <b>Functional data</b> | Cable entry               | Cable gland with strain relief 2 x Ø6 mm   |
|                        | Sensor Technology         | CO <sub>2</sub> : NDIR (non dispersive infrared) dual channel<br>R.H.: with stainless steel wire mesh filter |
|                        | Communicative control     | Modbus RTU   |
|                        | Output signal active note | Output DC 0...5/10 V selectable with switch  |
|                        | Application               | Air  |

|                              |                                   |   |  |
|------------------------------|-----------------------------------|---|--|
| <b>Measuring data</b>        | Measuring values                  | CO <sub>2</sub><br>Temperature<br>Relative humidity<br>Absolute humidity<br>Enthalpies<br>Dew point   |  |
|                              | Measuring range CO <sub>2</sub>   | 0...2000 ppm<br>selectable via Modbus   |  |
|                              | Measuring range humidity          | 0...100% r.H.<br>selectable via Modbus  |  |
|                              | Measuring range temperature       | 0...50°C [30...120°F]<br>selectable via Modbus<br>Attention: max. measuring temperature is restricted by max. fluid temperature (see Safety data) |  |
|                              | Measuring range absolute humidity | 0...80 g/m <sup>3</sup><br>selectable via Modbus  |  |
|                              | Measuring range enthalpy          | 0...85 kJ/kg<br>selectable via Modbus   |  |
|                              | Measuring range dew point         | -20...80°C<br>selectable via Modbus   |  |
|                              | Accuracy CO <sub>2</sub>          | ±(50 ppm + 3% of measuring value)   |  |
|                              | Accuracy humidity                 | ±2% between 10...90% r.H. @ 21°C  |  |
|                              | Accuracy temperature active       | ±0.5°C @ 21°C [±0.9°F @ 70°F]   |  |
|                              | <b>Materials</b>                  | Cable gland   | PA6, black   |
|                              |                                   | Housing   | Cover: Lexan, orange<br>Bottom: Lexan, orange<br>Seal: 0467 NBR70, black<br>UV resistant |
|                              | <b>Safety data</b>                | Probe material  | PA6, black   |
|                              |                                   | Ambient humidity  | Max. 95% r.H., non-condensing  |
| Medium humidity              |                                   | Max. 95% r.H., non-condensing   |  |
| Ambient temperature          |                                   | 0...50°C [30...120°F]   |  |
| Fluid temperature            |                                   | 0...50°C [30...120°F]   |  |
| Operating condition air flow |                                   | min. 0.3 m/s<br>max. 12 m/s   |  |
| Protection class IEC/EN      |                                   | III Safety Extra-Low Voltage (SELV)   |  |
| Protection class UL          |                                   | UL Class 2 Supply   |  |
| EU Conformity                |                                   | CE Marking  |  |
| Certification IEC/EN         |                                   | IEC/EN 60730-1  |  |
| Certification UL             |                                   | cULus acc. to UL60730-1A/-2-9/-2-13, CAN/CSA E60730-1:02/-2-9   |  |
| Degree of protection IEC/EN  |                                   | IP65  |  |
| Quality Standard             |                                   | ISO 9001  |  |

**Safety notes**


This device has been designed for use in stationary heating, ventilation and air-conditioning systems and must not be used outside the specified field of application. Unauthorised modifications are prohibited. The product must not be used in relation with any equipment that in case of a failure may threaten humans, animals or assets.

Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Only authorised specialists may carry out installation. All applicable legal or institutional installation regulations must be complied during installation.

The device contains electrical and electronic components and must not be disposed of as household refuse. All locally valid regulations and requirements must be observed.

**Remarks**

|   |  |
|---|--|
| <b>General remarks concerning sensors</b>                       | Sensing devices with a transducer should always be operated in the middle of the measuring range to avoid deviations at the measuring end points. The ambient temperature of transducer electronics should be kept constant. The transducers must be operated at a constant supply voltage ( $\pm 0.2$ V). When switching the supply voltage on/off, onsite power surges must be avoided.  |
| <b>Build-up of Self-Heating by Electrical Dissipative Power</b> | Temperature sensors with electronic components always have a dissipative power which affects the temperature measurement of the ambient air. The dissipation in active temperature sensors shows a linear increase with rising operating voltage. The dissipative power should be taken into account when measuring temperature. In case of a fixed operating voltage ( $\pm 0.2$ V) this is normally done by adding or reducing a constant offset value. As Belimo transducers work with a variable operating voltage, only one operating voltage can be taken into consideration, for reasons of production engineering. Transducers 0...10 V / 4...20 mA have a standard setting at an operating voltage of DC 24 V. That means, that at this voltage, the expected measuring error of the output signal will be the least. For other operating voltages, the offset error will be increased by a changing power loss of the sensor electronics. If a re-calibration should become necessary later directly on the sensor, this can be done by means of a trimming potentiometer on the sensor board. |
| <b>Application Notice for Humidity Sensors</b>                  | Refrain from touching the sensitive humidity sensor/element. Touching the sensitive surface will void warranty.<br><br>For standard environmental conditions the manufacturing accuracy specified in the datasheet will be covered by the calibration warranty for two years. When exposed to harsh environmental conditions such as high ambient temperature and/or high levels of humidity, or presence of aggressive gases (i.e. chlorine, ozone, ammonia) the sensor element may be affected and readings may be outside specified accuracy. Replacement of deteriorated humidity sensors due to harsh environmental conditions are not subject of the general warranty.   |
| <b>Information Self-Calibration Feature CO<sub>2</sub></b>      | All CO <sub>2</sub> sensors are subject to drift caused by the aging process of the components, resulting in regular re-calibration or replacement of units. However, the dual channel technology integrates automatic self-calibration technology vs. common used ABC-Logic sensors. Dual channel self-calibration technology is ideally suited for applications operating 24/7 hours such as those in hospitals or other commercial applications. Manual calibration is not required.  |


**Scope of delivery**

| Scope of delivery | Description                                      | Type      |
|-------------------|--|-----------|
|                   | Mounting flange for duct sensor 19.5 mm, Plastic | A-22D-A35 |
|                   | Cable Gland with strain relief Ø6...8 mm         |           |

**Accessories**

| Optional accessories | Description  | Type        |
|----------------------|--|-------------|
|                      | Replacement filter, wire mesh, Stainless steel                 | A-22D-A06   |
|                      | Connection adapter, M20, for cable 1 x 6 mm, Multipack 10 pcs. | A-22G-A01.1 |
|                      | Connection adapter, M20, for cable 2 x 6 mm, Multipack 10 pcs. | A-22G-A02.1 |

Wiring diagram

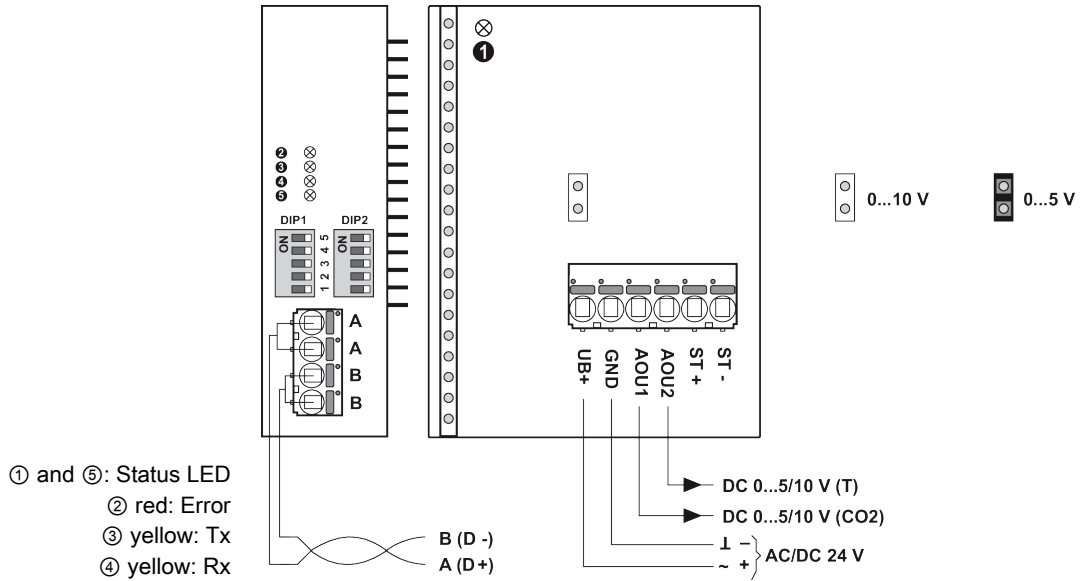

- ① and ⑤: Status LED
- ② red: Error
- ③ yellow: Tx
- ④ yellow: Rx

**Detailed documentation**

The separate document Sensor Modbus-Register informs about Modbus register, addressing, parity and bus termination (DIP1: address, DIP2: baud rate, parity, bus termination)

**Notes Wiring RS485**

Connection via safety isolating transformer.


Parallel connection of other devices possible. Observe the performance data.



The wiring of the line for BACnet MS/TP / Modbus RTU is to be carried out in accordance with applicable RS485 regulations.


Modbus / BACnet: Supply and communication are not galvanically isolated. Connect earth signal of the devices with one another.

**Wiring RS485 (Modbus RTU & BACnet MS/TP)**

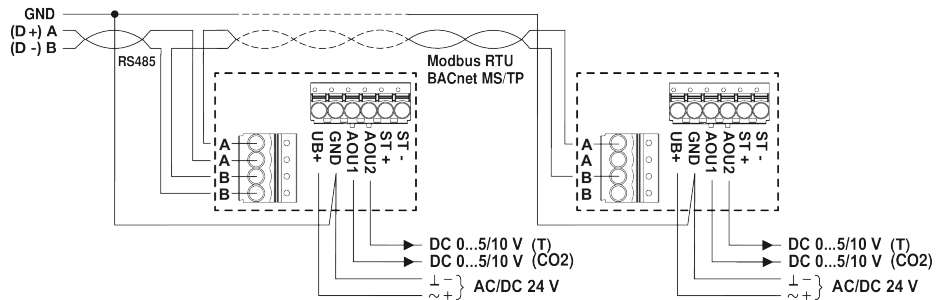

Dimensions

Dimensions

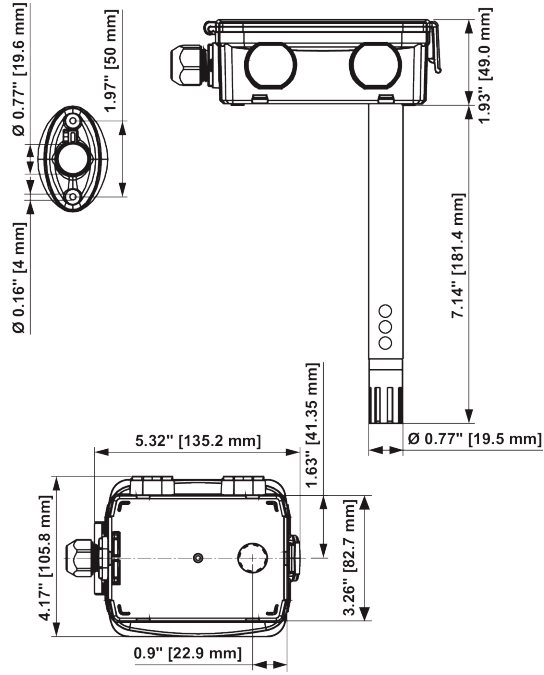

| Type     | Probe length | Weight  |
|----------|--------------|---------|
| 22DTM-15 | 180 mm       | 0.28 kg |